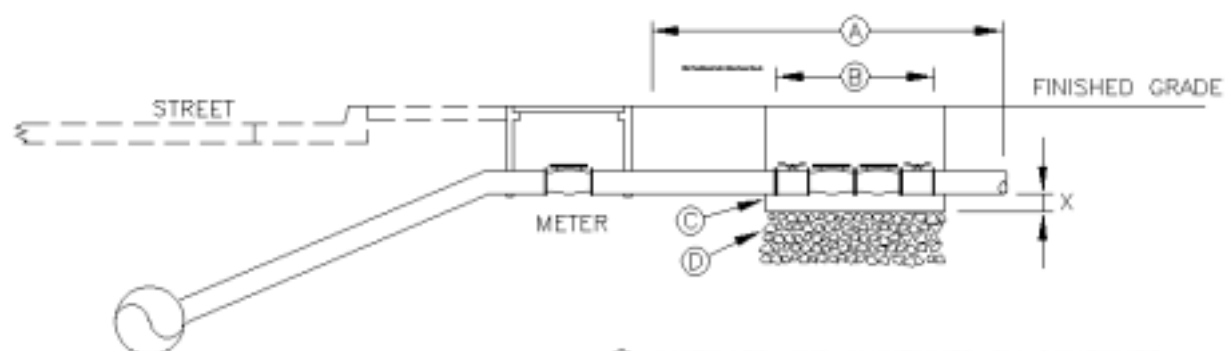


FIGURE A

- Ⓐ INSTALLED AND MAINTAINED BY CONSUMER PER CITY OF GRAND PRAIRIE BUILDING AND SAFETY SPECIFICATIONS.
- Ⓑ USC APPROVED DOUBLE CHECK ASSEMBLY WITH RESILIENT SEATED SHUT-OFF VALVES, TEST COCK FITTINGS AND BRASS CAPS.
- Ⓒ FIBERGLASS OR PLASTIC BOX (SEE FIGURE A FOR APPROXIMATE DIMENSIONS)
- Ⓓ 6" COARSE GRAVEL OR CRUSHED ROCK

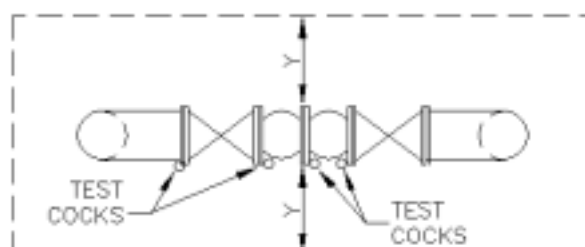


TABLE OF CLEARANCES	3/4" TO 2" DEVICE	2" AND ABOVE
X	6"	12"
Y	6"	12"

NOTES

- 1 THE ASSEMBLY MUST BE TESTED INSPECTED AND APPROVED BY THE CITY ENVIRONMENTAL SERVICES DEPARTMENT (972-237-8055) IMMEDIATELY AFTER INSTALLATION.
- 2 NO CONNECTIONS OR TEES ARE PERMITTED BETWEEN THE METER AND BACKFLOW PREVENTER. STRAINERS WILL BE REVIEWED ON AN INDIVIDUAL BASIS.
- 3 ASSEMBLY TO BE MAINTAINED BY OWNER AND TESTED ANNUALLY AFTER FIRST YEAR BY LICENSED TESTER REGISTERED WITH THE CITY ENVIRONMENTAL SERVICES DEPARTMENT.



REVISION 2/03
SCALE: NONE

CITY OF GRAND PRAIRIE

TYPICAL UNDERGROUND
INSTALLATION OF DOUBLE CHECK
VALVE BACKFLOW PREVENTION
ASSEMBLY STANDARDS

DRAWING
NUMBER